



PRI.

440	U	460	PRI	440	V	460	480	440	W	460	480	N
-----	---	-----	-----	-----	---	-----	-----	-----	---	-----	-----	---

SEC.

u	200	220	v	SEC	200	220	w	200	220	μ	$\oplus$
---	-----	-----	---	-----	-----	-----	---	-----	-----	-------	----------

PRI.	PT-90	10P	M6	(2.5~3.7N・m)
SEC.	PT-150	9P	M8	(6.0~9.0N・m)
加電	PT-150	2P	M8	(6.0~9.0N・m)

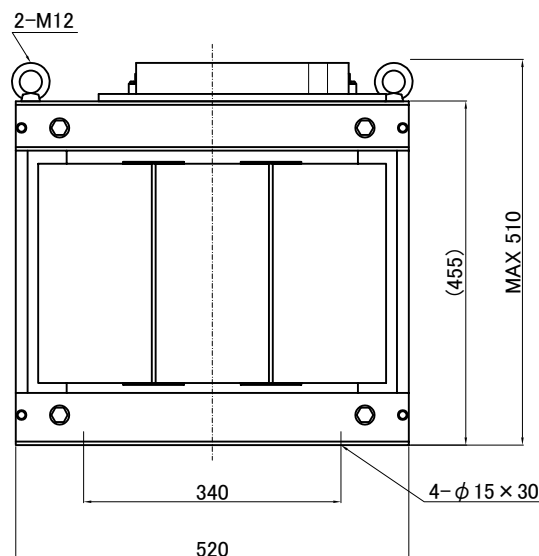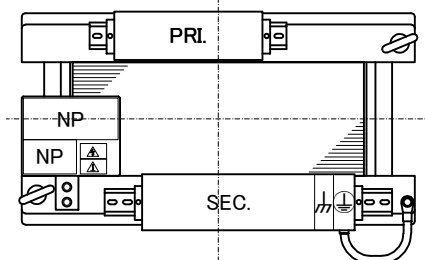

Standard C22.2 No. 47-M90
EN61558-1, EN61558-2-4
IEC61558-1, IEC61558-2-4
BS EN IEC 63000

UL File No.	
EN, IECマーク	Non short circuit proof
EN, IEC Mark	isolating transformer

Pri. Circuit Breaker	100A
Sec. Circuit Breaker	100A
(IEC60947-2 or IEC60934)	

改訂
Ver. 4

訂正記号	訂正日	訂正事項	改訂	訂正者	訂正記号	訂正日	訂正事項	改訂	訂正者
Rev. No.	Date	Content	Ver.	Unassigned	Rev. No.	Date	Content	Ver.	Assigned
△	13.01.30	Rewrite drawing	2	N.Marukai		21.07.01	Rewrite drawing	4	N.Takebayashi
△	13.01.30	EN, IEC standard updated	2	N.Marukai	△3	21.07.01	EN, IEC standard updated, BS standard added	4	N.Takebayashi
△2	19.04.16	Corrected the ambient temperature value(25℃→40℃)	3	N.Marukai					